



EUROfusion

EUROFUSION WPBOP-CP(16) 15786

L. Malinowski et al.

Analysis of the secondary circuit of the DEMO fusion power plant using GateCycle

Preprint of Paper to be submitted for publication in
Proceedings of 29th Symposium on Fusion Technology (SOFT
2016)



This work has been carried out within the framework of the EUROfusion Consortium and has received funding from the Euratom research and training programme 2014-2018 under grant agreement No 633053. The views and opinions expressed herein do not necessarily reflect those of the European Commission.

This document is intended for publication in the open literature. It is made available on the clear understanding that it may not be further circulated and extracts or references may not be published prior to publication of the original when applicable, or without the consent of the Publications Officer, EUROfusion Programme Management Unit, Culham Science Centre, Abingdon, Oxon, OX14 3DB, UK or e-mail Publications.Officer@euro-fusion.org

Enquiries about Copyright and reproduction should be addressed to the Publications Officer, EUROfusion Programme Management Unit, Culham Science Centre, Abingdon, Oxon, OX14 3DB, UK or e-mail Publications.Officer@euro-fusion.org

The contents of this preprint and all other EUROfusion Preprints, Reports and Conference Papers are available to view online free at <http://www.euro-fusionscipub.org>. This site has full search facilities and e-mail alert options. In the JET specific papers the diagrams contained within the PDFs on this site are hyperlinked

Analysis of the secondary circuit of the DEMO fusion power plant using GateCycle

Leszek Malinowski^a, Monika Lewandowska^a, Fabio Giannetti^b

^a*West Pomeranian University of Technology, Szczecin, 70-310 Szczecin, Poland*

^b*Sapienza University of Rome, 244 - 00186 Rome, Italy*

Conceptual activities on the DEMO fusion power plant design are progressing in Europe under the lead of the EUROfusion Consortium. According to the current EU DEMO plant design, the Primary Heat Transfer System (PHTS) transfers heat from the nuclear heat sources, i.e. breeding blanket, divertor and (optionally) vacuum vessel, to the Power Conversion System (PCS) responsible for generating electric energy. To mitigate issues related to the pulsed DEMO operation, adding the Energy Storage System (ESS) filled with molten salt, between the PHTS and PCS, has been proposed. One of the four candidate options for the realization of the blanket and the related PHTS is the Water-Cooled Lithium-Lead Breeding Blanket (WCLL). In the present work a detailed GateCycle model of the DEMO PCS, for the option WCLL, with the ESS was created and its operation at the nominal conditions (plasma burn) and at the reduced heating power (dwell period) was studied. It was demonstrated, that during the dwell period the amount of heat provided from the ESS to the considered cycle can be safely reduced down to 50% of its nominal value. This is an important information for the ESS designers which should help in its proper sizing.

Keywords: DEMO, Power Conversion System, dwell period, operation at reduced power, GateCycle

1. Introduction

ITER is planned to be the research type tokamak which will achieve the energy breakeven point. The next step towards the realization of fusion energy will be DEMO – the first demonstration fusion power plant producing grid electricity at the level of a few hundred MW. DEMO plant designers are required to maximize the conversion efficiency of the primary and secondary plant circuits. The Primary Heat Transfer System (PHTS) transfers heat from the nuclear heat sources, i.e. breeding blanket, divertor and (optionally) vacuum vessel, to the secondary circuit called Power Conversion System (PCS) responsible for generating electric energy. One of the four candidate options for the realization of the blanket and the related PHTS is the Water-Cooled Lithium-Lead Breeding Blanket (WCLL) [1,2]. According to the current EU DEMO baseline design, the DEMO reactor will produce thermal power in pulses lasting about 2 hours interrupted by dwell periods of about half an hour [3]. To mitigate problems related with the pulsed operation of DEMO the Intermediate Heat Transfer System between the PHTS and PCS has been proposed, which includes the Energy Storage System (ESS) filled with solar molten salt [1]. Size of the ESS will depend on the heat demand of the PCS during the dwell phase.

The aim of the present work is to create a detailed GateCycle (GC) model of the steam/water PCS cycle for the WCLL option with the ESS and to analyze operation of this circuit at nominal conditions (during plasma burns) and at the reduced heating power (during the dwell period). The developed model of the PCS cycle is used to study the impact of the operating conditions on the cycle efficiency and its basic operating parameters.

2. Model description

2.1 Basic assumptions

The basic concept of the considered PCS cycle was proposed in [4]. Here we study its more refined version, which is schematically presented in Fig. 1. The proposed cycle utilizes heat provided from the breeding blanket via the ESS and from the divertor. As a first stage of our analysis operation at the nominal conditions is studied, aimed at the design of the PCS components. In the second stage, operation at the reduced heating power is considered in the “off design” mode, i.e. with the fixed design of the circuit components. We assume that during the dwell phase heating power provided from the ESS is gradually reduced down to 50% of its nominal value, whereas heating power of the divertor source immediately drops to 0.

2.2 Energy calculations

Shaft power of the i -th turbine ($i = 1, 2$) is computed as:

$$W_{t_i} = \eta_{t_m} \left[\dot{m}_{in} h_{in} - \sum_{j=1}^{n_{se}} \dot{m}_{se_j} h_{se_j} - \dot{m}_{out} h_{out} \right], \quad (1)$$

where the number of steam extractions $n_{se} = 2$ for the HP turbine (ST1 in Fig. 1) and 1 for the LP turbine (ST2), respectively, h is the water specific enthalpy, and the mechanical efficiency of each turbine is assumed to be $\eta_{t_m} = 0.998$ [4]. The electrical power produced by the generator (gross power) is calculated as:

$$W_{gross} = \eta_{gen} (W_{t1} + W_{t2}), \quad (2)$$

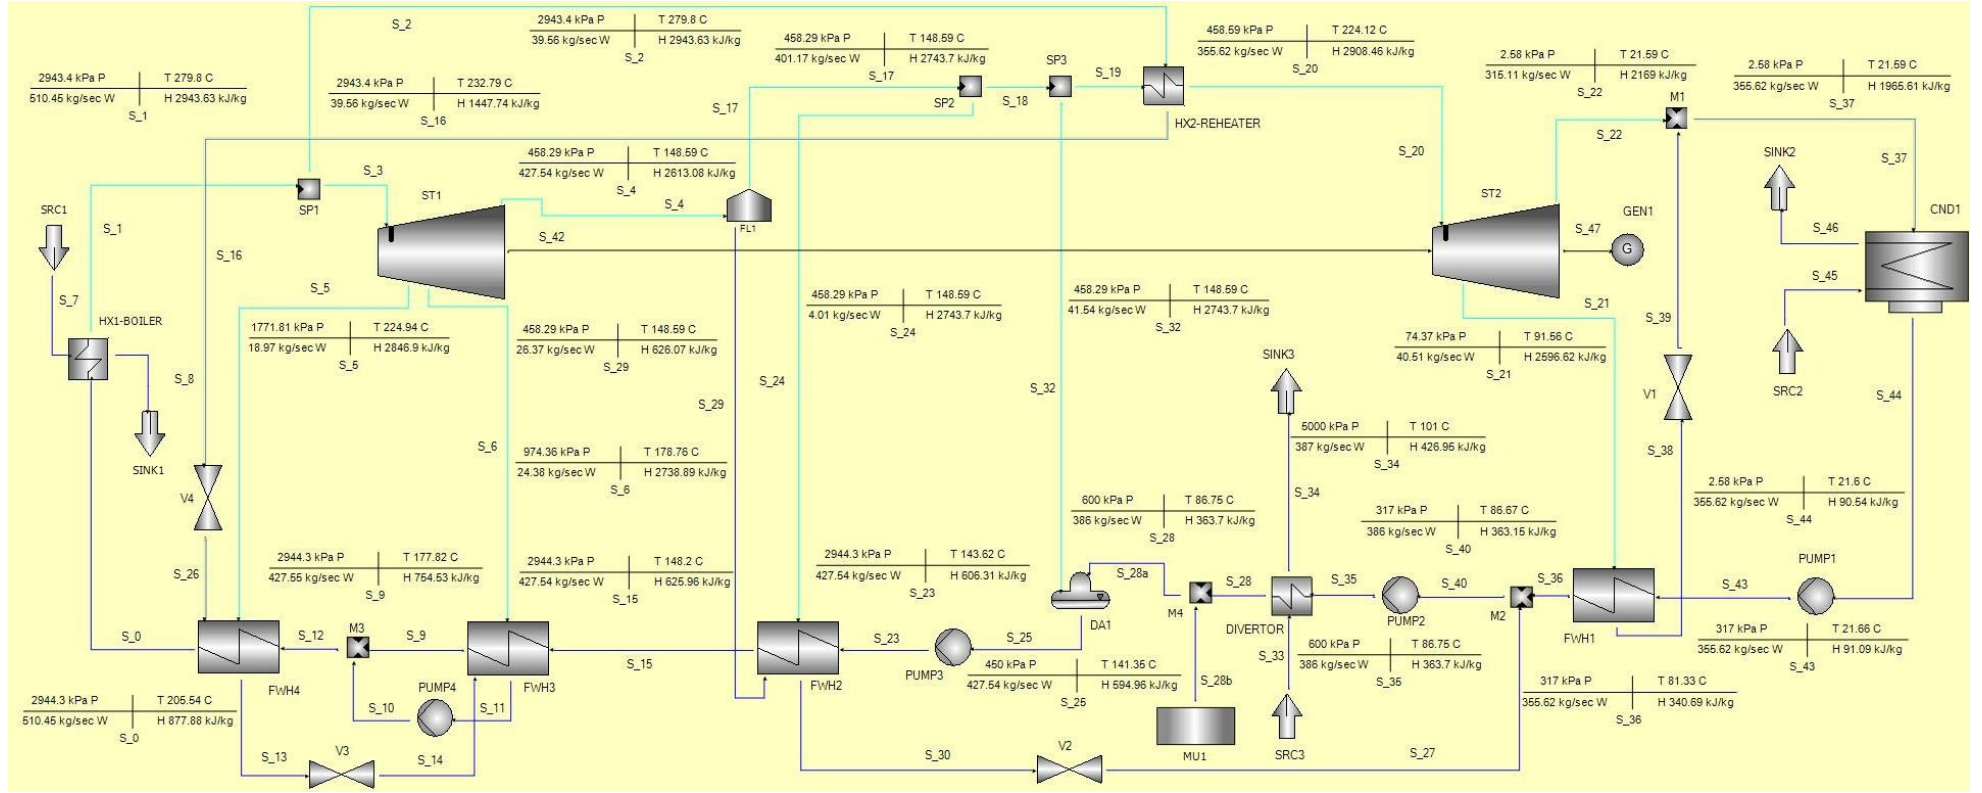


Fig. 1. Scheme of the considered GC model of the DEMO PCS and the values of the main streams parameters for its operation during the dwell period ($\dot{Q}_{DIV} = 0$ MW, $\dot{Q}_B = 1065$ MW, i.e. 50% of the nominal value).

where $\eta_{gen} = 0.97$ is the assumed generator efficiency [4,5]. The net electrical power of the cycle is defined as:

$$W_{cycle} = W_{gen} + \sum_{i=1}^4 W_{pump_i} \quad (3)$$

where W_{pump_i} is the power of the i -th pump:

$$W_{pump_i} = \dot{m}_{pump_i} (h_{in_i} - h_{out_i}) / \eta_{pump} \quad (4)$$

where $\eta_{pump} = 0.934$ is the pump motor efficiency [6]. The rate of heat supplied to the cycle is computed from:

$$\dot{Q}_{cycle} = \dot{Q}_B + \dot{Q}_{DIV} \quad (5)$$

where \dot{Q}_B and \dot{Q}_{DIV} is the rate of heat supplied from the blanket via the ESS (HX1 BOILER in Fig. 1) and from the divertor (HX DIVERTOR), respectively. At the nominal operating conditions $\dot{Q}_B = 2129$ MW, whereas $\dot{Q}_{DIV} = 148$ MW [4]. The gross and the net electrical efficiency of the cycle are calculated as:

$$\eta_{gross} = W_{gen} / \dot{Q}_{cycle} \quad (7a)$$

$$\eta_{cycle} = W_{cycle} / \dot{Q}_{cycle} \quad (7b)$$

It should be noted, however, that the actual net power of the DEMO plant and the related net plant electrical efficiency will be much lower than the respective values resulting from Eqs. (3) and (7b), since in the present analysis we have not taken into account power consumption of the DEMO auxiliary systems, such as e.g. those required for heating and current drive in the plasma, cryogenic plant, vacuum pumps, etc.

3. Results

We obtained the convergent GC model (in the

Table 1. Parameters of the selected streams at the nominal operating conditions ($\dot{Q}_B = 2129$ MW, $\dot{Q}_{DIV} = 148$ MW).

Stream	\dot{m} (kg/s)	T (°C)	p (kPa)	quality
S_0	1 218	243	6 405	0
S_1	1 218	280	6 400	1
S_3	1 122	280	6 400	1
S_5	96	247	3 800	0.9384
S_6	74	215	2 100	0.8925
S_4	952	180	1 000	0.8528
S_19	753	180	1 000	1
S_20	753	261	1 000	1
S_21	85	114	162	0.9732
S_22	668	32	4.8	0.8398
S_37	753	32	4.8	0.7612
S_44	753	32	4.8	0
S_36	753	90	317	0

S_35	933	107	600	0
S_28a	933	144	600	0
S_25	952	154	600	0
S_15	952	175	6 405	0
S_9	952	211	6 405	0
S_12	1 218	212	6 405	0

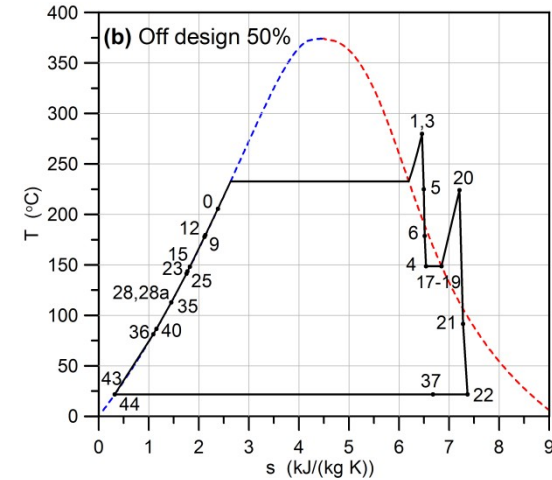
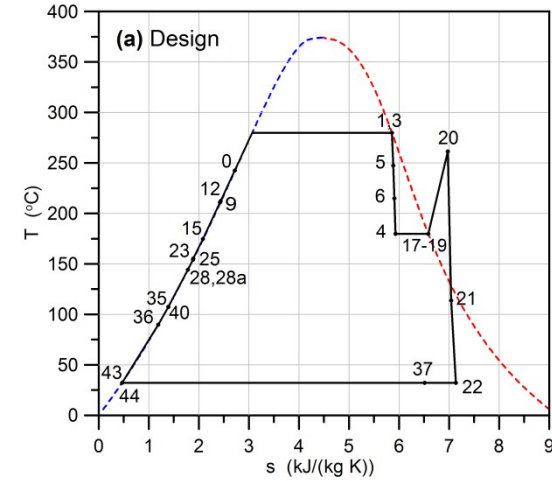


Fig. 2. T-s diagram for the considered cycle (a) at the nominal operating conditions, (b) for operation during the dwell period ($\dot{Q}_B = 1065 \text{ MW}$, $\dot{Q}_{DIV} = 0 \text{ MW}$).

“Design” mode) for the whole considered PCS cycle at the nominal conditions. The main operating parameters of this model are compiled in Table 1, whereas the respective T-s diagram is shown in Fig. 2a. Then we obtained the convergent GC models (in the “off design” mode) for several cases with the reduced heating power, namely with $\dot{Q}_{DIV} = 0 \text{ MW}$ and \dot{Q}_B (duty of the heat exchanger HX1) consecutively reduced to 80, 75, 70, 65, 60, 55 and 50% of its nominal value. The values of the operating parameters for the latter case are listed in Fig. 1. It can be noticed, that at the reduced heating power temperature at the inlet of the HP turbine (stream S_3 in Fig. 1) is the same as in the nominal operating conditions. Steam quality in turbines at the reduced heating power slightly increases, which is beneficial for the turbines internal efficiencies.

The power of the considered cycle, its electrical efficiency and the mass flow rate of water heated by the thermal energy provided from the ESS (stream S_0 in Fig. 1), at the nominal operating conditions (plasma burn) and at the reduced heating power (dwell phase) is presented in Figs. 3-5. It is seen, that the gross electrical

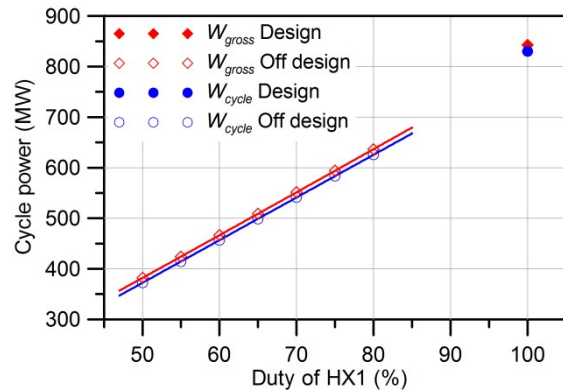


Fig. 4. Power of the considered cycle at the nominal operating conditions and at the reduced heating power.

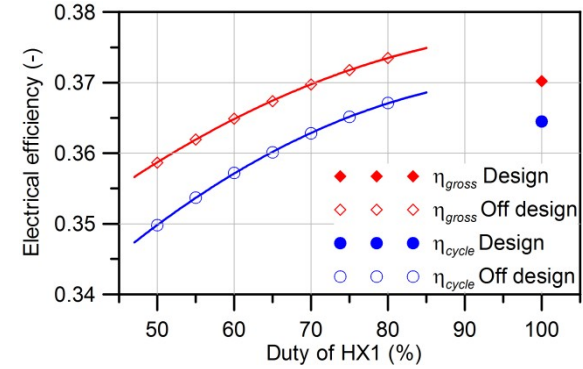


Fig. 5. Electrical efficiency of the cycle at the nominal operating conditions and at the reduced heating power.

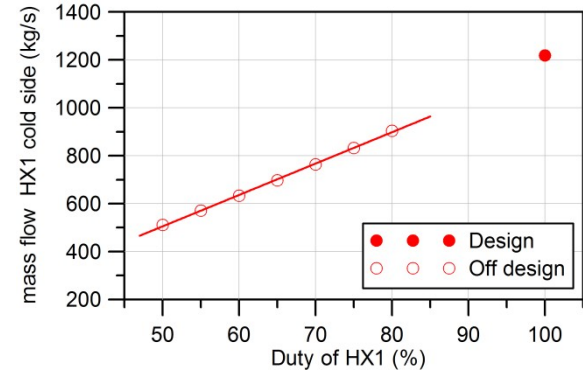


Fig. 6. Mass flow rate of water heated by the thermal energy provided from the ESS, at the nominal operating conditions and at the reduced heating power.

power of the cycle varies in the range 843-382 MW, whereas the gross electrical efficiency - in the range 37.0 - 35.9 %. The pump work, which varies in the range 13 -9.5 MW, does not affect significantly the electrical output. Although utilizing heat from the divertor source increases the cycle power, but slightly reduces its electrical

efficiency. Reduction of the heating power provided to the cycle is accompanied by the reduction of the water/steam mass flow rate in the main circuit.

4. Summary and conclusions

The detailed convergent GC model of the steam/water PCS cycle for the DEMO power plant (option WCLL with the ESS) was created and its operation at the nominal conditions and at the reduced heating power was studied. It was demonstrated, that during the dwell period the amount of heat provided from the ESS to the cycle can be safely reduced down to 50% of its nominal value. This is an important information for the designers of the ESS which should help in its proper sizing.

Acknowledgments

This work has been carried out within the framework of the EUROfusion Consortium and has received funding from the Euratom research and training programme 2014-2018 under grant agreement No 633053. The views and opinions expressed herein do not necessarily reflect those of the European Commission. This scientific work was also partly supported by Polish Ministry of Science and Higher

Education within the framework of the scientific financial resources in the year 2016 allocated for the realization of the international co-financed project.

References

- [1] A. Del Nevo, *et al.*, WCLL breeding blanket design and integration for DEMO 2015: status and perspectives, 2016, presented at the SOFT 2016 conference.
- [2] C. Harrington, D. McLaughlin and S. Norrman, Dynamic modeling of a water-cooled blanket and energy storage options for a pulsed DEMO, presented at the SOFT 2016 conference.
- [3] G. Federici, *et al.*, Overview of the design approach and prioritization of R&D activities towards an EU DEMO, Fusion Eng. Des. 109–111 (2016) 1464–1474.
- [4] E. Bubelis, Conceptual Design Definition for an Intermediate Cooling Loop Configuration and Coolant, Final report for the task BOP-3.1.4 (2014) (IDM reference: EFDA_D_2HDVN9).
- [5] J. I. Linares, A. Cantizano, B. Y. Moratilla, V. Martín-Palacios, L. Batet, Supercritical CO₂ Brayton power cycles for DEMO (demonstration power plant) fusion reactor based on dual coolant lithium lead blanket, Energy 98 (2016) 271-283.
- [6] S. Norrman, Thermodynamic modelling activities with APROS Code for Helium as primary coolant, Final report for the task BOP-3.1.1 (2015) (IDM reference: EFDA_D_2JMZ4K).